

SUCÇÃO: DN 65 RECALQUE: DN 40

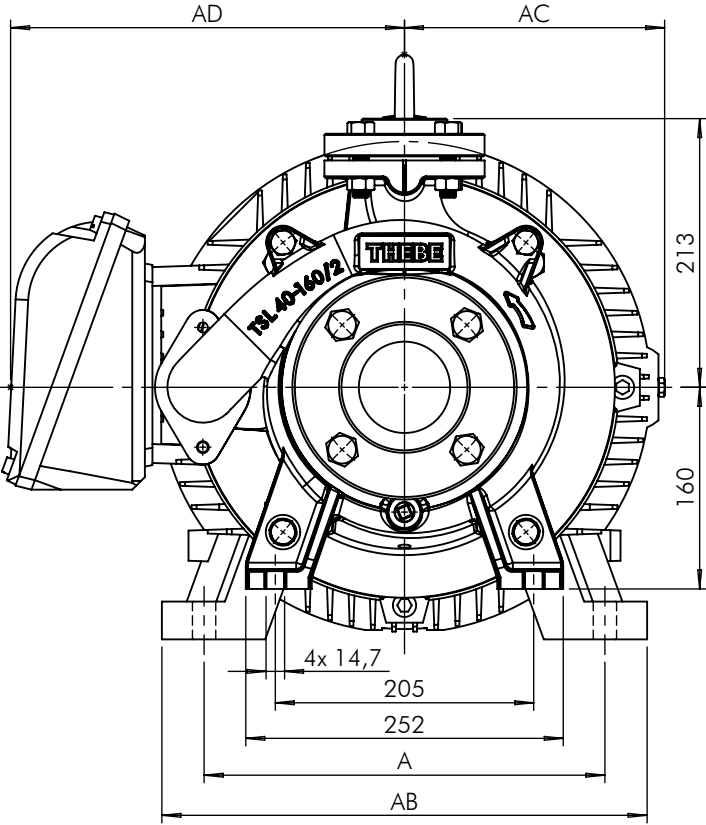
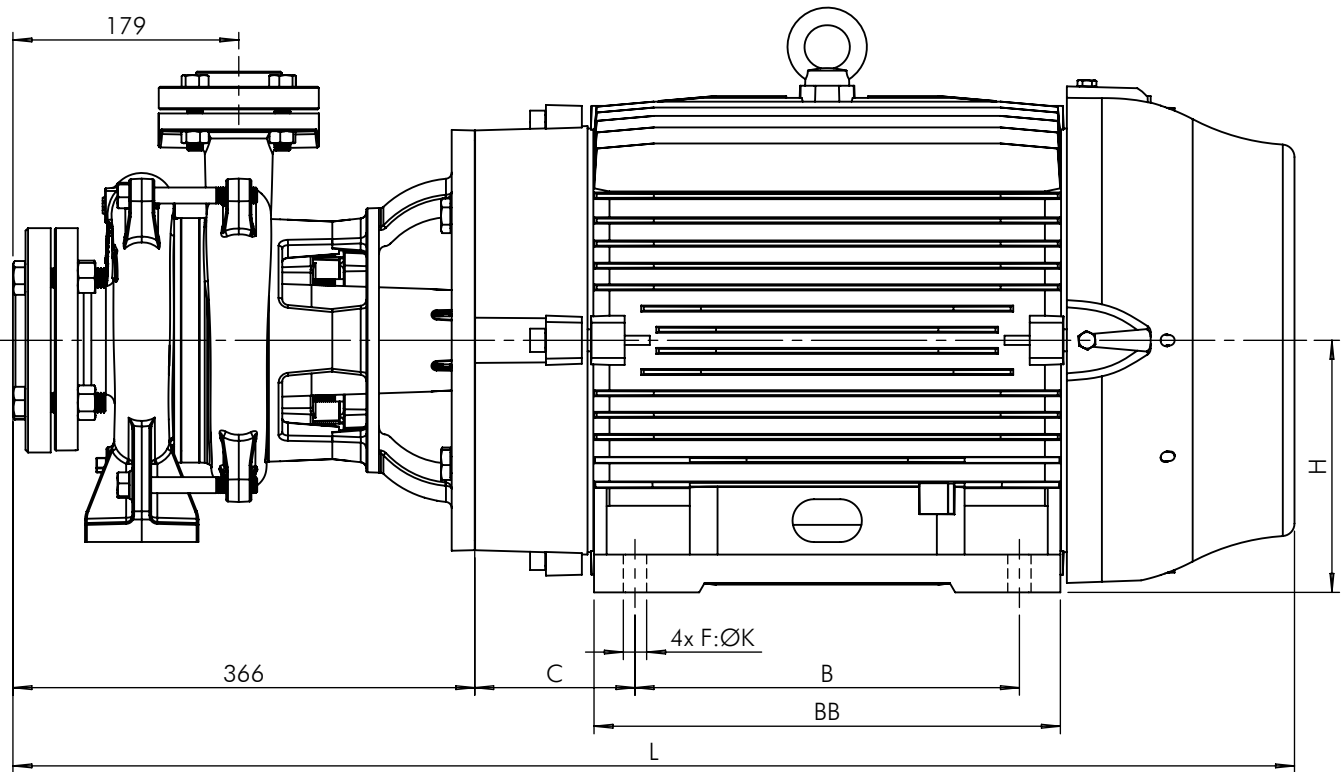




Tabela de Códigos e Medidas

Modelo	CV	Flange	Trifásico Carçaça	Monof. 2 polos	Código	L	A	AB	AD	AC	B	BB	C	ØK	H
TSL 40.160/2	15	FC-184	132M	---	116.00.98014R	771	216	248	212 205	135	178	225	89 83	12	132
			---	132L	117.01.980144	796									
	20	FC-184	160M	---	116.00.98015R	849	254	308	255	156	210	254	108	14,5	160
	25				116.00.98016R										
	30	FC-279	180M	---	116.00.98017R	915	279	350	275	179	241	294	121	180	200
	40		200M		116.00.98018R	974									
	50		200L		116.00.98019R	1018									

 BOMBAS HIDRÁULICAS EBARA CORPORATION	EXECUTADO	Wiliam C.	26/04/19			---	OED-19	17/05/19	Garcia
	VERIFICADO	Gustavo	26/04/19						
	APROVADO	Garcia	26/04/19						
		NOME	DATA CRIAÇÃO	OBSERVAÇÃO	REVISÃO	LOCAL	Nº DOCUM.	DATA	APROVADO

Bomba TSL 40-160/2 Monobloco Selo 980406

Em caso de dúvidas pergunte! MATERIAL : PESO: FOLHA 1 de 1 UNID.: Milímetro (mm)